

PERFORMANCE  
MADE  
SMARTER

# Safety manual

## 9202

### *Pulse isolator*



TEMPERATURE | I.S. INTERFACES | COMMUNICATION INTERFACES | MULTIFUNCTIONAL | ISOLATION | DISPLAY

Version No. V8R0

**PR**  
electronics

# 6 Product Pillars

## *to meet your every need*

### Individually outstanding, unrivalled in combination

With our innovative, patented technologies, we make signal conditioning smarter and simpler. Our portfolio is composed of six product areas, where we offer a wide range of analog and digital devices covering over a thousand applications in industrial and factory automation. All our products comply with or surpass the highest industry standards, ensuring reliability in even the harshest of environments and have a 5-year warranty for greater peace of mind.



Our range of temperature transmitters and sensors provides the highest level of signal integrity from the measurement point to your control system. You can convert industrial process temperature signals to analog, bus or digital communications using a highly reliable point-to-point solution with a fast response time, automatic self-calibration, sensor error detection, low drift, and top EMC performance in any environment.



We deliver the safest signals by validating our products against the toughest safety standards. Through our commitment to innovation, we have made pioneering achievements in developing I.S. interfaces with SIL 2 Full Assessment that are both efficient and cost-effective. Our comprehensive range of analog and digital intrinsically safe isolation barriers offers multifunctional inputs and outputs, making PR an easy-to-implement site standard. Our backplanes further simplify large installations and provide seamless integration to standard DCS systems.



We provide inexpensive, easy-to-use, future-ready communication interfaces that can access your PR installed base of products. All the interfaces are detachable, have a built-in display for readout of process values and diagnostics, and can be configured via push-buttons. Product specific functionality includes communication via Modbus and Bluetooth and remote access using our PR Process Supervisor (PPS) application, available for iOS and Android.



Our unique range of single devices covering multiple applications is easily deployable as your site standard. Having one variant that applies to a broad range of applications can reduce your installation time and training, and greatly simplify spare parts management at your facilities. Our devices are designed for long-term signal accuracy, low power consumption, immunity to electrical noise and simple programming.



Our compact, fast, high-quality 6 mm isolators are based on microprocessor technology to provide exceptional performance and EMC-immunity for dedicated applications at a very low total cost of ownership. They can be stacked both vertically and horizontally with no air gap separation between units required.



Our display range is characterized by its flexibility and stability. The devices meet nearly every demand for display readout of process signals and have universal input and power supply capabilities. They provide a real-time measurement of your process value no matter the industry and are engineered to provide a user-friendly and reliable relay of information, even in demanding environments.

# Safety manual

## Pulse isolator

### 9202

This safety manual is valid for the following product versions:

9202-002

9202-003

#### 1. Table of contents

1. Observed standards . . . . .	5
2. Acronyms and abbreviations . . . . .	5
3. Purpose of the product . . . . .	5
4. Assumptions and restrictions for use of the product . . . . .	6
4.1 Basic safety specifications . . . . .	6
4.2 Associated equipment . . . . .	6
4.2.1 Relay output . . . . .	6
4.2.2 Opto output . . . . .	6
4.2.3 Field device . . . . .	6
4.3 Failure rates . . . . .	6
4.4 Safe parameterization . . . . .	6
4.5 Installation in hazardous areas . . . . .	6
4.6 FMEDA Report . . . . .	6
5. Functional specification of the safety functions . . . . .	6
6. Functional specification of the non-safety functions . . . . .	6
7. Safety parameters . . . . .	7
8. Hardware and software configuration . . . . .	7
9. Failure category . . . . .	7
10. Periodic proof test procedure . . . . .	7
11. Procedures to repair or replace the product . . . . .	7
12. Maintenance . . . . .	7
13. Documentation for routing diagram . . . . .	8
13.1 In general . . . . .	8
13.2 Further explanations . . . . .	8
13.2.1 Password protection . . . . .	8
13.2.2 Cable fault information via display front 45xx . . . . .	8

13.3 Advanced functions (ADV.SET) .....	8
13.3.1 Display setup (DISP) .....	8
13.3.2 Password (PASS) .....	8
13.3.3 Language (LANG) .....	8
13.3.4 Power rail (RAIL) .....	8
13.3.5 Safety integrity level (SIL) .....	8
14. Safe parameterization - user responsibility .....	9
14.1 Safety-related configuration parameters .....	9
14.2 Verification procedure .....	9
14.2.1 If no password is set .....	9
14.2.2 If password is set .....	9
14.2.3 If any parameter is found to be incorrect during verification .....	10
14.3 Functional test .....	10
15. Fault reaction and restart condition .....	10
16. User interface .....	11
16.1 Scrolling help texts in display line 3 .....	11
16.2 Routing diagram .....	12
16.3 Routing diagram, advanced settings (ADV.SET) .....	13
17. Connections diagram .....	14

## 1. Observed standards

Standard	Description
IEC 61508	Functional Safety of electrical / electronic / programmable electronic safety-related systems
IEC 61508-2:2010	Part 2: Requirements for electrical / electronic / programmable electronic safety-related systems
IEC 61508-3:1998	Part 3: Software requirements
IEC 61326-3-1:2008	Immunity requirements for safety-related systems

## 2. Acronyms and abbreviations

Acronym / Abbreviation	Designation	Description
Element		Term defined by IEC 61508 as “part of a subsystem comprising a single component or any group of components that performs one or more element safety functions”.
PFD	Probability of Failure on Demand	This is the likelihood of dangerous safety function failures occurring on demand.
PFH	Probability of dangerous Failure per Hour	The term “Probability” is misleading, as IEC 61508 defines a Rate.
SFF	Safe Failure Fraction	Safe Failure Fraction summarises the fraction of failures which lead to a safe state and the fraction of failures which will be detected by diagnostic measures and lead to a defined safety action.
SIF	Safety Integrity Function	Function that provides fault detection (to ensure the necessary safety integrity for the safety functions).
SIL	Safety Integrity Level	The international standard IEC 61508 specifies four discrete safety integrity levels (SIL 1 to SIL 4). Each level corresponds to a specific probability range regarding the failure of a safety function.

## 3. Purpose of the product

Pulse isolator for transmission of signals to the safe area from NAMUR sensors and mechanical switches installed in the hazardous area.

The module can be mounted in the safe area and in zone 2 / div. 2 and receive signals from zone 0, 1, 2, 20, 21 and 22 / Class I/II/III, Div. 1, Gr. A-G.

Error events, including cable breakage, are monitored and signalled via the individual status relay and/or a collective electronic signal via the power rail.

The 9202 has been designed, developed and certified for use in SIL 2 applications according to the requirements of IEC 61508.

## 4. Assumptions and restrictions for use of the product

### 4.1 Basic safety specifications

Operational temperature range . . . . .	-20...+60°C
Storage temperature range. . . . .	-20...+85°C
Power supply type. . . . .	Double or reinforced
Supply voltage . . . . .	19.2...31.2 VDC
Output pulse length, min. . . . .	40 µs
Mounting area . . . . .	Zone 2 / Division 2 or safe area
Mounting environment . . . . .	Pollution degree 2 or better

### 4.2 Associated equipment

#### 4.2.1 Relay output

The relay output shall only be connected to equipment which has a current limiting function of 2 A.

#### 4.2.2 Opto output

The opto output signals are fed to SIL 2 compliant inputs of a safety PLC specified to receive a frequency of 5 kHz and a pulse length down to 40 microseconds or the field device signal pulse length minus 60 microseconds.

#### 4.2.3 Field device

The field device must provide a minimum pulse length of 100 microseconds.

### 4.3 Failure rates

Failure rates are constant, wear-out mechanisms are not included.

External power supply failure rates are not included.

Cable breakage / short-circuit error detection shall be enabled.

### 4.4 Safe parameterization

The user is responsible for verifying the correctness of the configuration parameters. (See section 14 Safe parameterization - user responsibility).

Manual override may not be used for safety applications.

Parameterization and verification for SIL applications is only possible using the menu structure in PR Display / programming front products (PR 4501, 4510, 4511 or 4512). See section 16: User interface.

### 4.5 Installation in hazardous areas

The IECEx Installation drawing, ATEX Installation drawing and FM Installation drawing shall be followed if the products are installed in or connected to hazardous areas.

### 4.6 FMEDA Report

The FMEDA report "PR 06-03-19 R018 FMEDA 9202 V3 R3" is issued by exida.

The report can be downloaded from the PR website [www.prelectronics.com](http://www.prelectronics.com).

It is easily found by entering 9202 in the search field. From the results, open the corresponding link e.g. "9202B Pulse isolator" and locate the FMEDA report in the Supplementary documentation folder to the right.

## 5. Functional specification of the safety functions

Pulse isolator as well as supply of NAMUR sensors and mechanical switches with cable error detection installed in the hazardous area. Cable error detection only works with NAMUR sensors or with the use of external resistors  $R_s$  and  $R_p$ . See connections diagram at page 14 (switch, cable fault).

An undetected dangerous failure is defined as if the output does not correspond to the applied input signal (inclusive presence of a sensor/cable error), and is not in safe state, while operating in SIL mode.

The two channels on the device shall not be used in the same safety function, e.g. to increase the hardware fault tolerance of the device (to achieve a higher SIL), as they contain common components. The two channels may be used in separate safety instrumented functions if due regard is given to common cause failures.

## 6. Functional specification of the non-safety functions

The status relay (terminal 33 and 34), error signal on power rail (terminal 91) and LED outputs are not suitable for use in any Safety Instrumented Function.

## 7. Safety parameters

All figures for probability of failures are specified in the FMEDA report issued by Exida, see section 4.6.

	Relay
Demand response time, opto output	<125 $\mu$ s
Demand response time, relay output	<10 ms
Demand rate	1000 seconds
Mean Time To Repair (MTTR)	8 hours
Diagnostic test interval	10 seconds
Component Type	B (HFT=0)
SIL capability	SIL 2
Description of the "Safe State", opto output	High impedance
Description of the "Safe State", relay output	De-energized
Relay lifetime (Note <sup>1</sup> )	100 000 times

Note<sup>1</sup>: The user must calculate the product lifetime with regard to the relay lifetime.

## 8. Hardware and software configuration

All configurations of software and hardware versions are fixed from factory, and cannot be changed by end-user or reseller. This manual only covers products labelled with the product version (or range of versions) specified on the front page.

## 9. Failure category

All failure rates and failure categories are specified in the FMEDA report issued by exida, see section 4.6.

## 10. Periodic proof test procedure

Step	Action
1	Bypass the safety PLC or take other appropriate action to avoid a false trip
2	Connect a simulator identical to the input setup
3	Perform an ON / OFF signal for each channel
4	Observe whether the output channel acts as expected
5	Restore the input terminals to full operation
6	Remove the bypass from the safety PLC or otherwise restore normal operation

This test will detect approximately 95% of possible "du" (dangerous undetected) failures in the module. The proof test is equivalent to the functional test.

## 11. Procedures to repair or replace the product

Any failures that are detected and that compromise functional safety should be reported to the sales department at PR electronics A/S.

Repair of the module and replacement of circuit breakers must be done by PR electronics A/S only.

## 12. Maintenance

No maintenance required.

## 13. Documentation for routing diagram

The routing diagram is shown in section 16.2.

### 13.1 In general

When configuring the 9202, you will be guided through all parameters and you can choose the settings which fit the application. For each menu there is a scrolling help text which is automatically shown in line 3 on the display. Configuration is carried out by use of the 3 function keys:

- ⏪ will increase the numerical value or choose the next parameter
- ⏩ will decrease the numerical value or choose the previous parameter
- ⏹ will accept the chosen value and proceed to the next menu

When configuration is completed, the display will return to the default state 1.0.

Pressing and holding ⏹ will return to the previous menu or return to the default state (1.0) without saving the changed values or parameters.

If no key is activated for 1 minute, the display will return to the default state (1.0) without saving the changed values or parameters.

### 13.2 Further explanations

#### 13.2.1 Password protection

Password protection: Programming access can be blocked by assigning a password. The password is saved in the device in order to ensure a high degree of protection against unauthorized modifications to the configuration. If the configured password is not known, please contact PR electronics support - [www.prelectronics.com/contact](http://www.prelectronics.com/contact).

Password protection is mandatory in SIL applications.

#### 13.2.2 Cable fault information via display front 45xx

Cable fault (see limits in the table) is displayed as CA.BR (cable break) or CA.SH (cable short-circuited). Cable fault is shown independently for each channel but the configuration is common for both channels. In case of cable fault the backlight flashes. This can be reset by pressing the 3 key. When the cable fault has been remedied, the module will return to normal operation.

### 13.3 Advanced functions (ADV.SET)

The device gives access to a number of advanced functions which can be reached by answering "Yes" to the point "ADV.SET".

#### 13.3.1 Display setup (DISP)

Here you can adjust the brightness contrast and the backlight. Setup of tag numbers with 5 alphanumerics. Selection of functional readout in line 2 and 3 of the display - choose between readout of digital output or tag no. When selecting "ALT" the readout toggles between digital output and tag no.

#### 13.3.2 Password (PASS)

Here you can choose a password between 0000 and 9999 in order to protect the device against unauthorized modifications to the configuration. The device is delivered default without password.

#### 13.3.3 Language (LANG)

In this menu you can choose between 7 different language versions of help texts that will appear in the menu. You can choose between UK, DE, FR, IT, ES, SE and DK.

#### 13.3.4 Power rail (RAIL)

In this menu it can be chosen if sensor errors are transmitted to the central surveillance in the PR 9410 power control device.

#### 13.3.5 Safety integrity level (SIL)

See section 14 - Safe parameterization - user responsibility



## 14. Safe parameterization - user responsibility

### 14.1 Safety-related configuration parameters

Parameters	Value	Description
CH1.FUN	DIR / INV	Direct / inverted channel function
CH2.FUN	DIR / INV	Direct / inverted channel function
CA.SH	YES	Enable cable short circuit error indication
CA.BR	YES	Enable cable breakage error indication
PASSW	0 - 9999	New password

The above safety-related configuration parameters are marked in red text in the routing diagrams and must be verified by the user in a SIL-configuration.

### 14.2 Verification procedure

The verification is done using the display / programming front PR 45xx and following the procedure described below.

#### 14.2.1 If no password is set

	Action	Display shows
1	Press OK	ADV.SET
2	Set (ADV.SET) to Yes and press OK	DISP SETUP
3	Step down to (SIL SETUP) and press OK	EN.SIL
4	Set (EN SIL) to YES and press OK	NEW.PAS
5	Set password to a number between 0 and 9999 and press OK (At this time the device starts operating in SIL mode with the entered configuration parameters!)	Verify⇒OPEN "briefly"⇒LOCK*
6	Verify Channel 1 function and press OK	CH1.FUN
7	Verify Channel 2 function and press OK	CH2.FUN
8	Verify password and press OK	PASSW
9	Verify SIL and press OK	

\* Open is shown briefly in the display

#### 14.2.2 If password is set

	Action	Display shows
1	Press OK	PASSW
2	Enter password and press OK	ADV.SET
3	Set (ADV.SET) to Yes and press OK	DISP SETUP
4	Step down to (SIL SETUP) and press OK	EN.SIL
5	Set (EN SIL) to YES and press OK (At this time the device starts operating in SIL mode with the entered configuration parameters!)	Verify⇒OPEN "briefly"⇒LOCK*
6	Verify Channel 1 function and press OK	CH1.FUN
7	Verify Channel 2 function and press OK	CH2.FUN
8	Verify password and press OK	PASSW
9	Verify SIL and press OK	

\* Open is shown briefly in the display

### 14.2.3 If any parameter is found to be incorrect during verification

Remove SIL-mode (by entering the password and setting EN.SIL to NO in the "ADV.SET -> SIL" setup menu).

Go through the setup menu and correct the parameter(s).

Repeat step 1 to 9 (with correct parameters).

### 14.3 Functional test

The user is responsible to make a functional test after verification of the safety parameters. The procedure for periodic proof test described in section 10 shall be used.

## 15. Fault reaction and restart condition

When the 9202 detects a fault the output will go to Safe State, in which the opto output will go to "high impedance" or the relay output will go to "de-energized".

If the fault is application-specific (cable error detection) the 9202 will restart when the fault has been corrected.

For device faults there are 2 ways of bringing the module out of Safe State.

1. Power cycle the module.
2. Bring the module out of SIL mode (choose "NO" in the menu point "EN.SIL"), and set it back to SIL mode again (choose "YES" in the menu point "EN.SIL" and verify the configuration).

## 16. User interface


### 16.1 Scrolling help texts in display line 3

- [01] Set correct password [ PASS ]
- [02] Enter advanced setup [ ADV.SET ]
- [03] Enable cable short circuit error indication [ CA.SH ]
- [04] Enable cable breakage error indication? [ CA.BR ]
- [05] Enable rail status signal output? [ RAIL.ER ]
- [06] Enter language setup [ SETUP ]
- [6/1] Enter password setup [ SETUP ]
- [6/2] Enter display setup [ SETUP ]
- [6/3] Enter rail setup [ SETUP ]
- [6/4] Enter SIL setup [ SETUP ]
- [07] Select Direct channel function [ CH1.FUN ] [CH2.FUN ]  
Select Inverted channel function [ CH1.FUN ] [ CH2.FUN ]
- [09] Adjust LCD contrast [ CONTRA ]
- [10] Adjust LCD backlight [ LIGHT ]
- [11] Write a 5-character channel TAG [ 'TAGON ] [ "TAGON ]
- [12] Show Output state in display [ D.OUT ]  
Show TAG in display  
Alternate information shown in display
- [13] Configuration SIL status (Open / Locked) [ CONFIG ]
- [14] Enable SIL configuration lock [ EN.SIL ]
- [15] Enable Password protection [ EN.PASS ]
- [16] Set New password [ NEW.PAS ]
- [17] Select Language [ LANGUA ]
- [18] Cable short circuit [ ICA.SH ] [ IIOFF ]
- [19] Cable breakage [ ION ] [ IICA.BR ]

### 16.2 Routing diagram

If no key is activated for 1 minute, the display will return to the default state 1.0 without saving configuration changes.

- ⏪ Increase value / choose next parameter
- ⏩ Decrease value / choose previous parameter
- ⏹ Save the chosen value and proceed to the next menu
- Hold ⏹ Back to previous menu / return to menu 1.0 without saving.

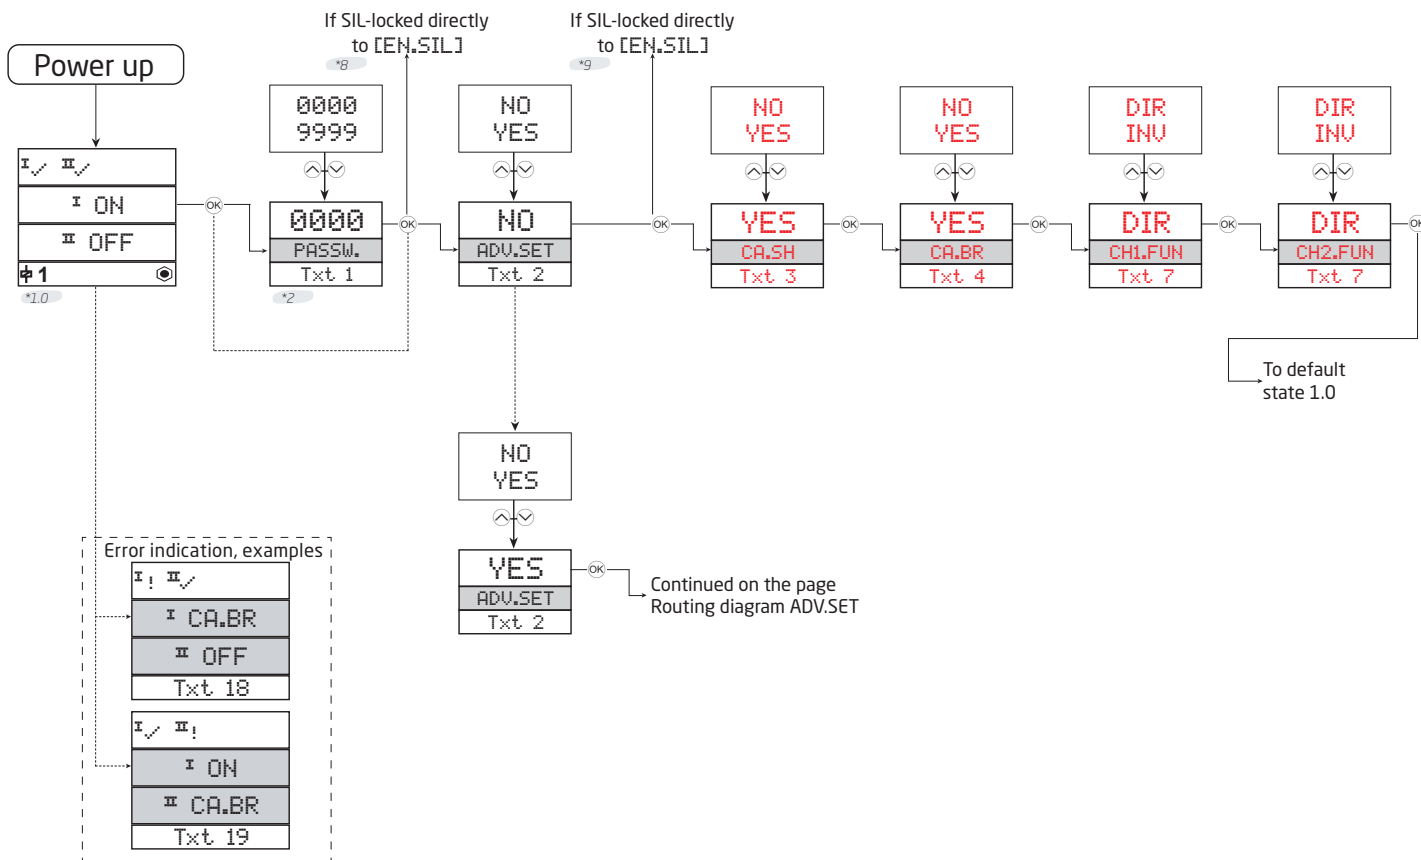

\*1.0 Default state.  
 Line 1 shows status for channel 1 and channel 2.  
 Line 2 shows status for sensor 1.  
 Line 3 shows status for sensor 2.  
 Line 4 indicates whether the device is SIL-locked.

\*2 Only if password-protected.


Line 1 symbols:  
 ✓ = OK. Flashing ✖ = error.  
 Line 2 and 3 symbols:  
 Input frequency > 1 Hz =  $\square$   $\square$   $\square$   
 Line 4 symbols:  
 Static dot = SIL-locked  
 Flashing dot = Not SIL-locked

Red text signifies safety parameters in a SIL configuration. See safety manual for details

\*8 Branching to SIL from this point valid for:  
 All 4501 devices.  
 4511 devices with serial no. lower than 211001001.  
 4512 devices with serial no. lower than 211065001.

\*9 Branching to SIL from this point valid for:  
 4511 devices with serial no from 211001001.  
 4512 devices with serial no from 211065001.


### 16.3 Routing diagram, advanced settings (ADV.SET)

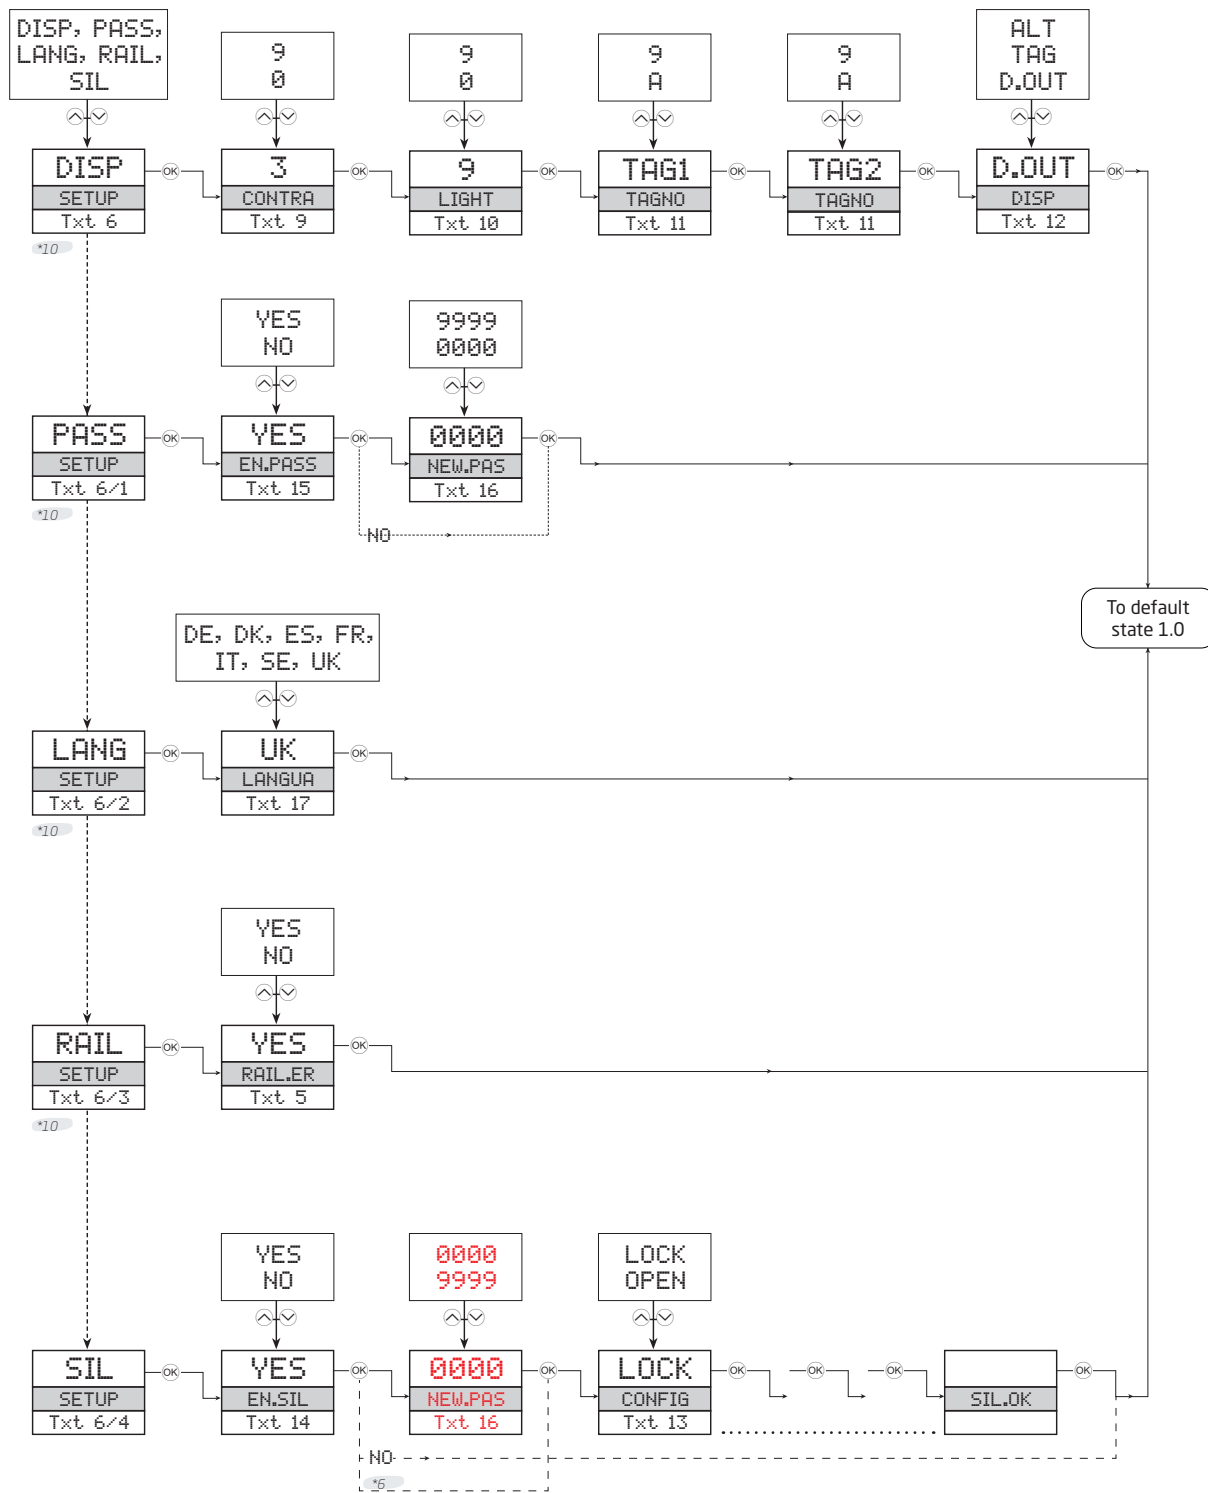

\*6 If password has been set.


\*10 Not available on PR 45xx if SIL-locked.  
Only for 4512 devices with serial no. from 211065001 and  
for 4511 devices with serial no. from 211001001.

# 17. Connections diagram

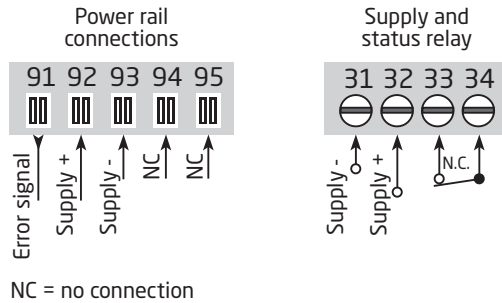


## Inputs:

(1)...(4) = See function description on page 12

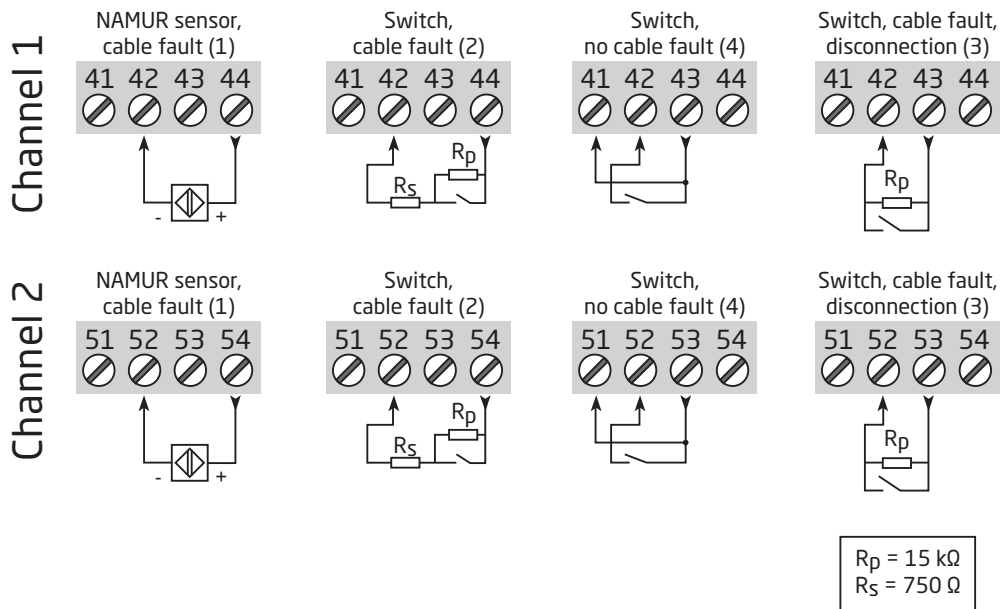

## Outputs:

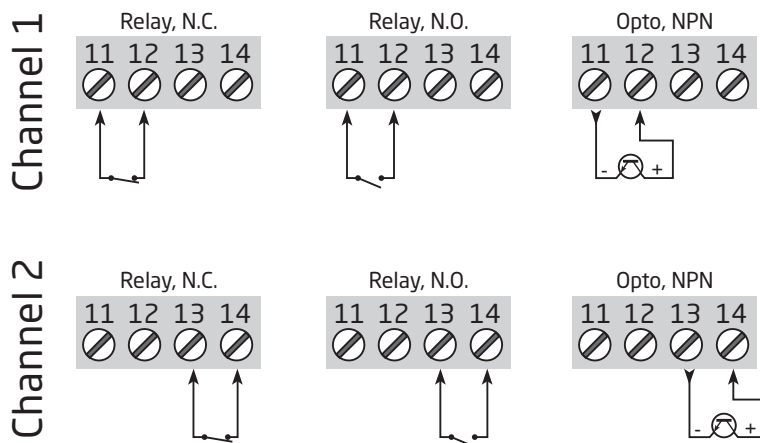

# We are near you, *all over the world*

**Our trusted red boxes are supported wherever you are**

All our devices are backed by expert service and a 5-year warranty. With each product you purchase, you receive personal technical support and guidance, day-to-day delivery, repair without charge within the warranty period and easily accessible documentation.

We are headquartered in Denmark, and have offices and authorized partners the world over. We are a local

business with a global reach. This means that we are always nearby and know your local markets well. We are committed to your satisfaction and provide PERFORMANCE MADE SMARTER all around the world.

For more information on our warranty program, or to meet with a sales representative in your region, visit [prelectronics.com](http://prelectronics.com).

# Benefit today from *PERFORMANCE MADE SMARTER*

PR electronics is the leading technology company specialized in making industrial process control safer, more reliable and more efficient. Since 1974, we have been dedicated to perfecting our core competence of innovating high precision technology with low power consumption. This dedication continues to set new standards for products communicating, monitoring and connecting our customers' process measurement points to their process control systems.

Our innovative, patented technologies are derived from our extensive R&D facilities and from having a great understanding of our customers' needs and processes. We are guided by principles of simplicity, focus, courage and excellence, enabling some of the world's greatest companies to achieve PERFORMANCE MADE SMARTER.